


SMOKE DETECTOR LOCATIONS

In dwellings where the bedrooms are separated and not grouped together, then smoke alarms should be located as shown below. Detectors shall be located as follows:

1. one inside each bedroom,
2. one outside and within 15' of each bedroom (and not separated by more than the door to the bedroom), and
3. one on each level/floor of the structure, including the basement.

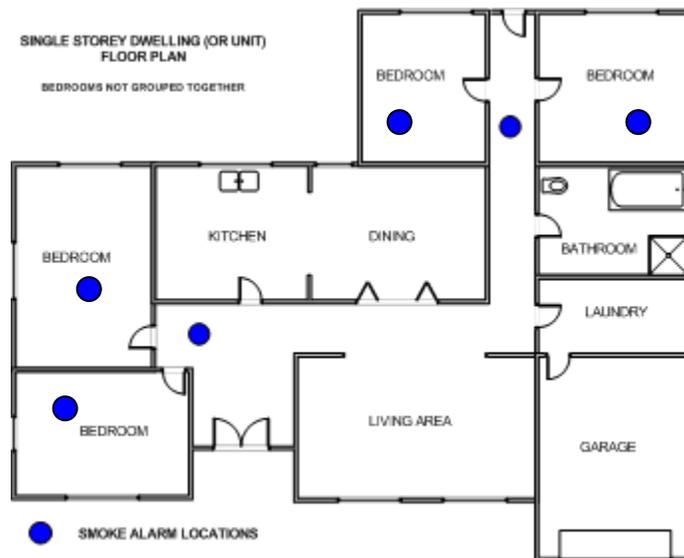

TWO STOREY DWELLING - GROUND FLOOR PLAN



● SMOKE ALARM LOCATIONS

TWO STOREY DWELLING - FIRST FLOOR PLAN

